


Factsheet of FTSP at Pokhara Metropolitan City

The Faecal Sludge Treatment Plant (FSTP) at Pokhara Metropolitan City was constructed in 2003 A.D. with financial support from Asian Development Bank (ADB) under the Pokhara Environmental Improvement Project.

At present, however, the structure has been demolished and is not available for FS treatment facility.

The factsheet is based on the information available on literatures.

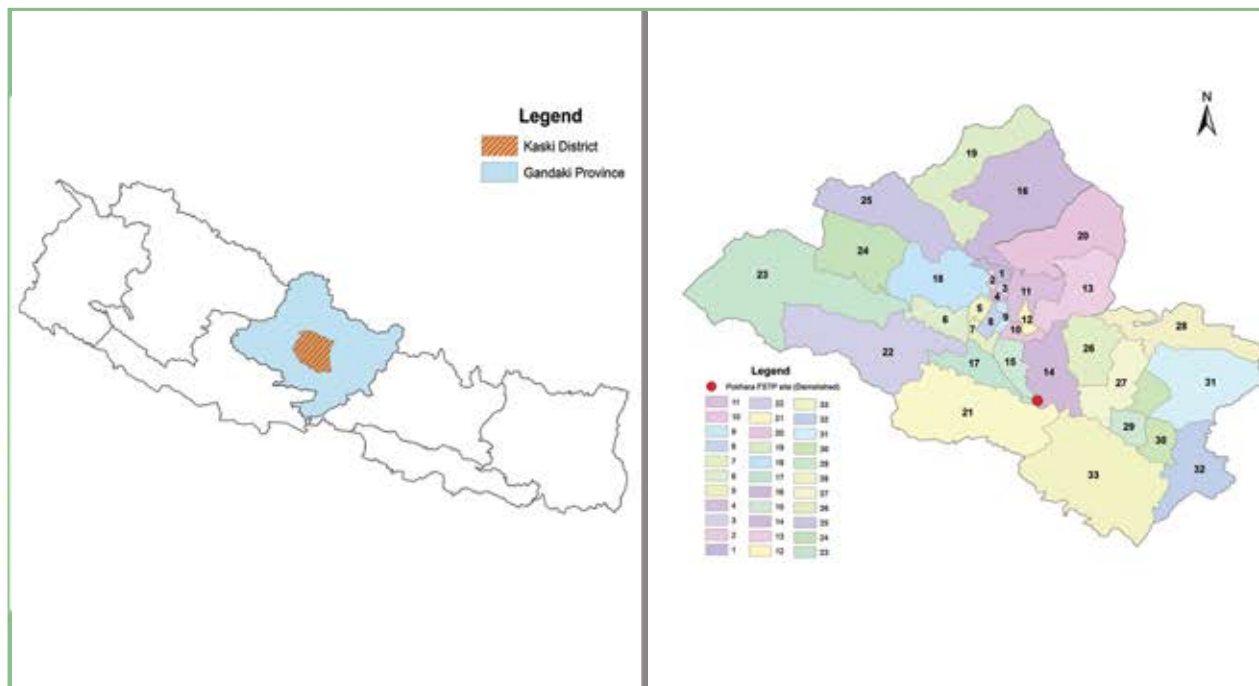

Components in Treatment Facility

Components	NOs.	Size
Sludge-Liquid Separation Unit		
Bar Screen	1	NA
Sludge Drying Bed	7	Each 235 m ²
Liquid Treatment Unit		
Horizontal Flow Constructed Wetlands (HFCW)	7	Each 590 m ³
Vertical Flow Constructed Wetlands (VFCW)	4	Each 375 m ³

Design Capacity and Operational Status

Design Capacity: 70 m³ per day for FS Treatment

Design Capacity: 228 m³ per day for leachate treatment

Operational Status: Non-Functional (Demolished)

We acknowledge representatives from Pokhara Municipality for your cordial support during this survey.

